

**UNDERGROUND METERED SERVICE  
(120/240V 60 HZ)**

**NOTES:**

- 1) The 6" x 8" wood post shall meet the requirement of the current M.D.O.T. Standard Specifications for Construction.
- 2) The meter and socket shall be as approved and required by the local power company.
- 3) All National Electric Code and local utility requirements for underground metered service shall be met.
- 4) For projects maintained by the Wayne Co. Department of Public Services (WCDPS), use rigid metal for conduit(s) from grade level to 10' (min.) above grade or as directed by the Engineer.

NOT TO SCALE

File: RefDoc/TR/Signals/Web/Sp Det/Fin/SIG211A.dgn Rev. 02/16/17




PREPARED BY  
TRAFFIC AND SAFETY

DRAWN BY: DJF  
CHECKED BY:

ENGINEER OF DELIVERY  
  
ENGINEER OF DEVELOPMENT  
(SPECIAL DETAIL)  
FHWA APPROVAL DATE

MICHIGAN DEPARTMENT OF TRANSPORTATION  
BUREAU OF HIGHWAYS DELIVERY STANDARD PLAN FOR  
**UNDERGROUND SERVICE/  
DISCONNECT WOOD POST**

PLAN DATE: **SIG-211-A** SHEET 1 of 2

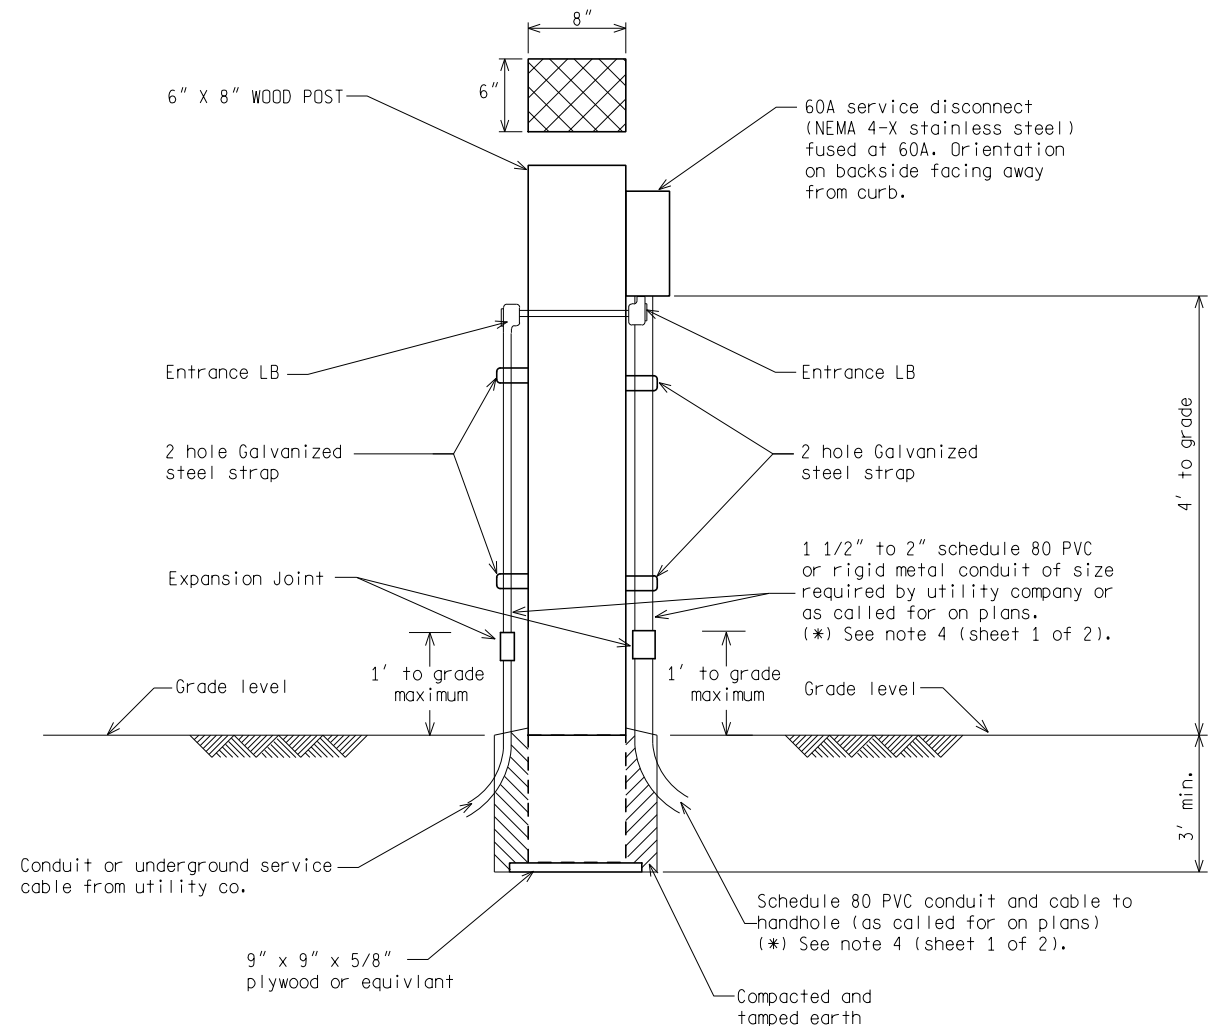

**UNDERGROUND NON-METERED SERVICE,  
(120/240V 60 HZ)**

**NOTES:**

- 1) The 6" x 8" wood post shall meet the requirement of the current M.D.O.T. Standard Specifications for Construction.
- 2) All National Electric Code and local utility requirements for underground non metered service shall be met.

NOT TO SCALE

MICHIGAN DEPARTMENT OF TRANSPORTATION  
BUREAU OF HIGHWAYS DELIVERY STANDARD PLAN (SPECIAL DETAIL)  
FHWA APPROVAL DATE

File: RefDoc/TR/Signals/Web/Sp Det/Fin/SIG211A.dgn Rev. 02/16/17

PLAN DATE

**SIG-211-A**

SHEET 2 of 2

AS-LET PLAN REVISIONS							
NO.	DATE	AUTH	DESCRIPTION	NO.	DATE	AUTH	DESCRIPTION



DATE:	CS:	DRAWING	SHEET
DESIGN UNIT:	JN:		
TSC:			
FILE:			