



(\*) NOTE:  
MARKING TAPE SHALL HAVE PROPER LOGO AS SUPPLIED  
BY THE ENGINEER AND INSTALLED BY THE CONTRACTOR.

**A** **DETAIL - DIRECT BURIAL CONDUIT(S)/CABLE(S)**  
N.T.S.

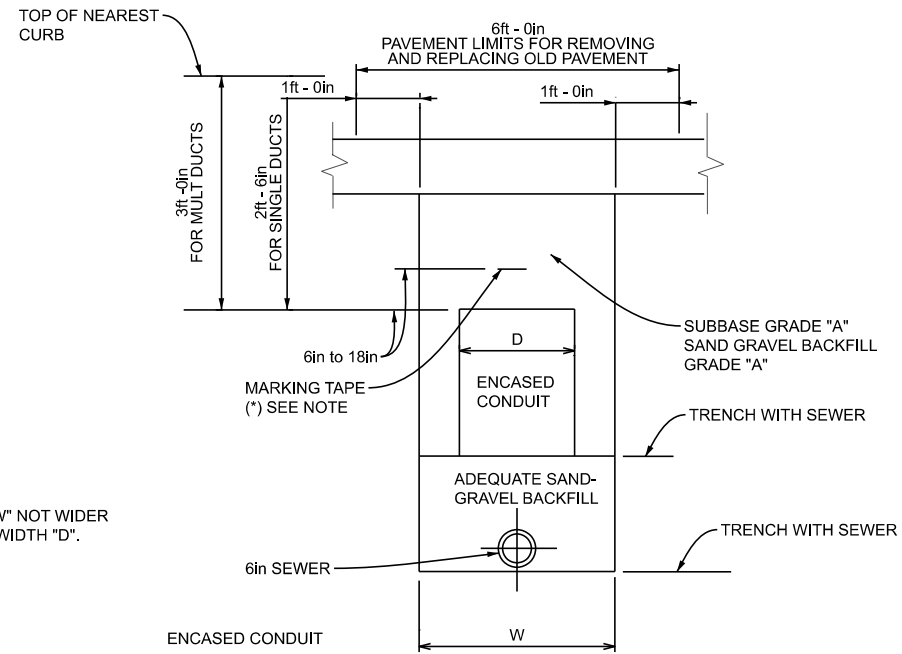

NOTE:  
PREFERRED TRENCH WIDTH "W" NOT WIDER  
THAN CONDUIT ENCASEMENT WIDTH "D".

**B** **TYPICAL - SECTION OF TRENCH**  
N.T.S.

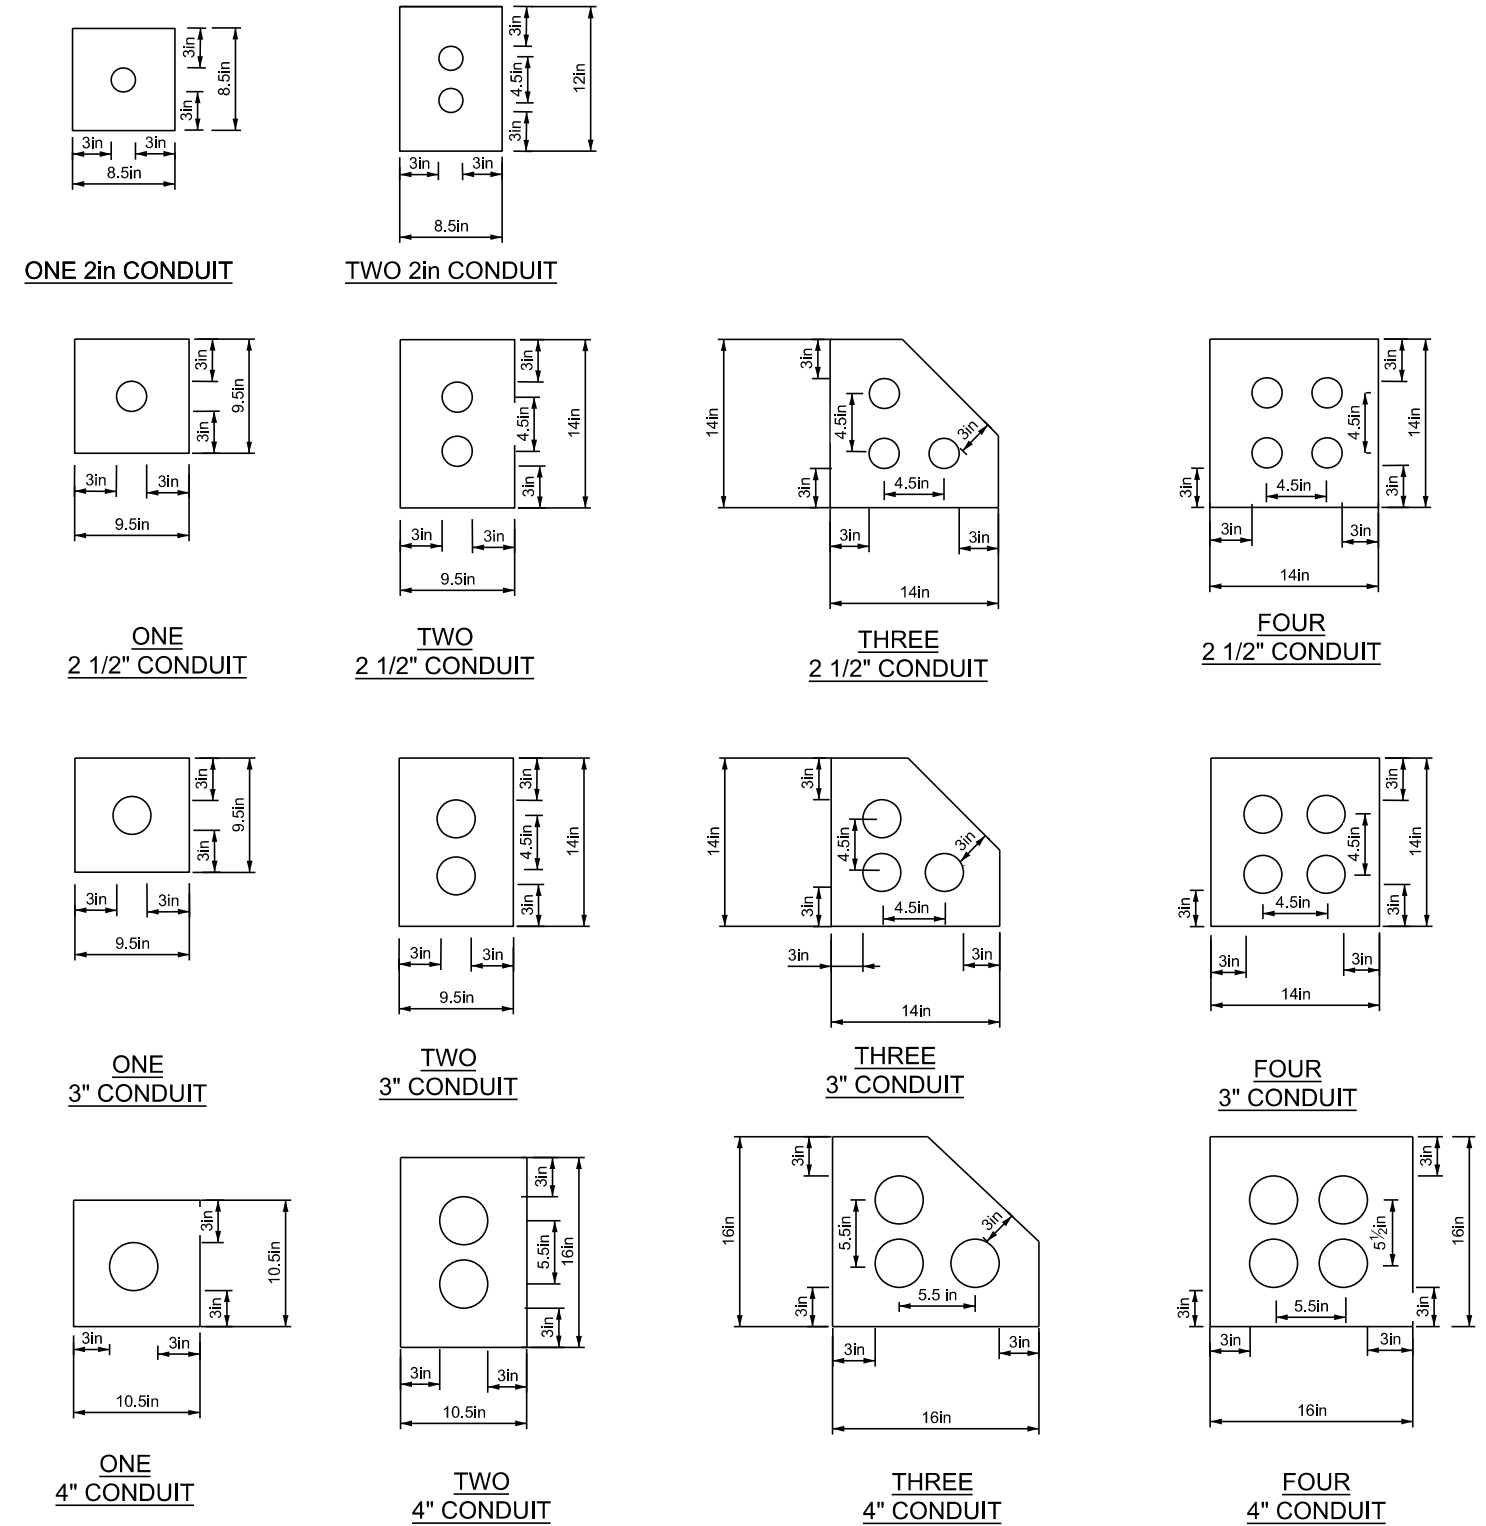

**C** **DETAIL - ENCASED SECTIONS**  
N.T.S. CONDUITS

APPROVED BY: \_\_\_\_\_  
DIRECTOR, BUREAU OF FIELD SERVICES



DEPARTMENT DIRECTOR  
BRADLEY C. WIEFERICH, PE

APPROVED BY: \_\_\_\_\_  
DIRECTOR, BUREAU OF DEVELOPMENT

(SPECIAL DETAIL)  
FHWA APPROVAL

07/12/23  
PLAN DATE

**SIG-250-A**

SHEET  
1 OF 2



DEPARTMENT DIRECTOR  
BRADLEY C. WIEFERICH, PE

(SPECIAL DETAIL)  
FHWA APPROVAL

07/12/23  
PLAN DATE

**SIG-250-A**

SHEET  
2 OF 2

SECT

STANDARD PLAN FOR  
CONDUIT  
(DIRECT BURIAL/ENCASE)

STANDARD PLAN FOR  
CONDUIT  
(DIRECT BURIAL/ENCASE)