



PLAN VIEW

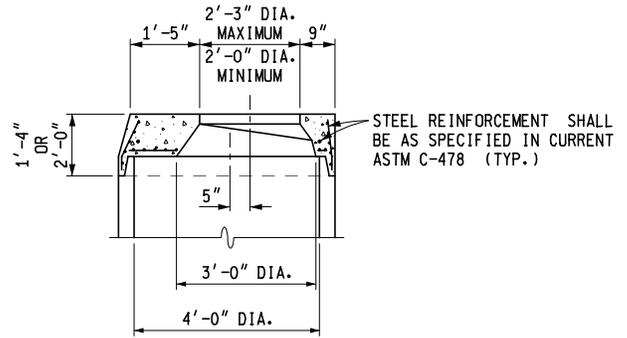


DETAIL FOR
1'-4" & 2'-0" TOP SECTIONS

SHAPE MAY VARY FROM DETAIL SHOWN BUT MUST COMPLY WITH ASTM C-478 AND JOINTS SHALL BE COMPATIBLE WITH THE RISER

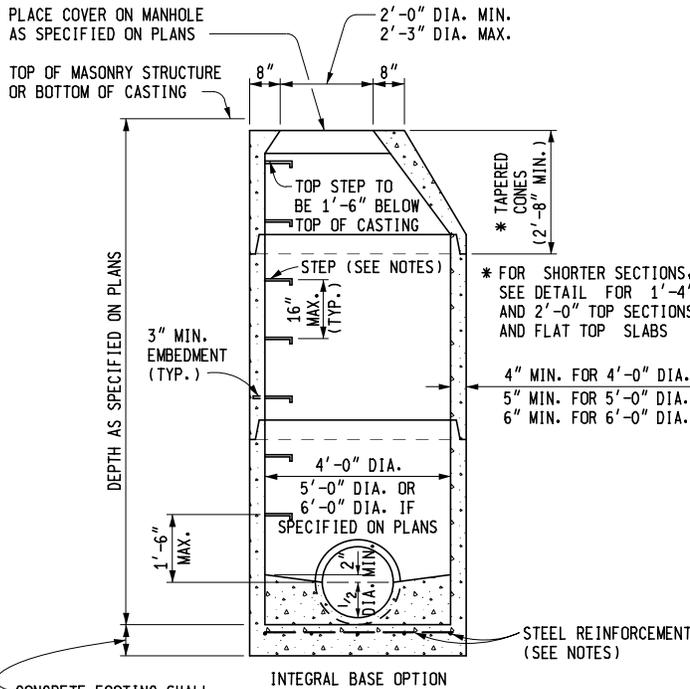



CONCRETE FOOTING SHALL BE 8" THICK FOR DEPTHS TO 25'-0" AND 1'-0" THICK FOR DEPTHS OVER 25'-0"



CONCRETE FOOTING SHALL BE 8" THICK FOR DEPTHS TO 25'-0" AND 1'-0" THICK FOR DEPTHS OVER 25'-0"

SECTION A - A
TYPICAL MANHOLE

PRECAST REINFORCED CONCRETE SHOWN
OTHER OPTIONS INCLUDE CONCRETE BLOCK, BRICK, OR CAST-IN-PLACE WALL SECTIONS
SEE TYPICAL WALL SECTIONS FOR WALL THICKNESS

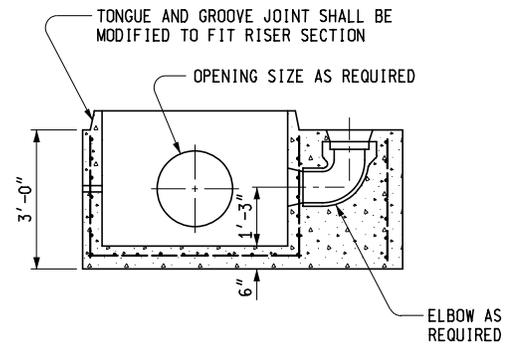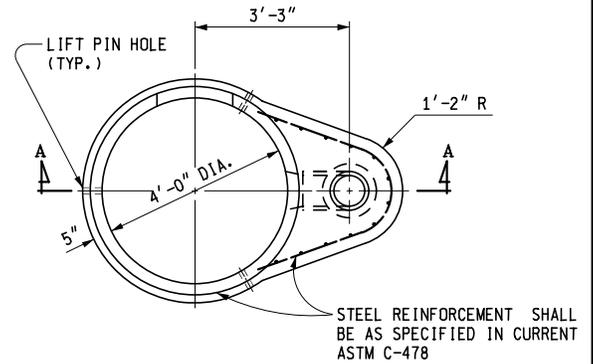

SECTION A - A

TYPICAL PRECAST REINFORCED
BOTTOM SECTION FOR DROP MANHOLE



PREPARED BY
DESIGN DIVISION

DRAWN BY: B.L.T.

CHECKED BY: W.K.P.

DEPARTMENT DIRECTOR
Paul C. Ajegba

APPROVED BY: Gregg Brunner, P.E. Gregg Brunner
Sep 19 2019 2:17 PM
DIRECTOR, BUREAU OF FIELD SERVICES

APPROVED BY: Bradley C. Wiefelrich Bradley C. Wiefelrich
Sep 19 2019 11:22 AM
DIRECTOR, BUREAU OF DEVELOPMENT

MICHIGAN DEPARTMENT OF TRANSPORTATION
BUREAU OF DEVELOPMENT STANDARD PLAN FOR


DRAINAGE STRUCTURES

5-18-2020
F.H.W.A. APPROVAL


9-19-2019
PLAN DATE

R-1-G


SHEET
1 OF 9

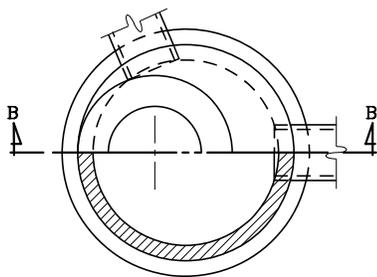


HALF SECTION A - A

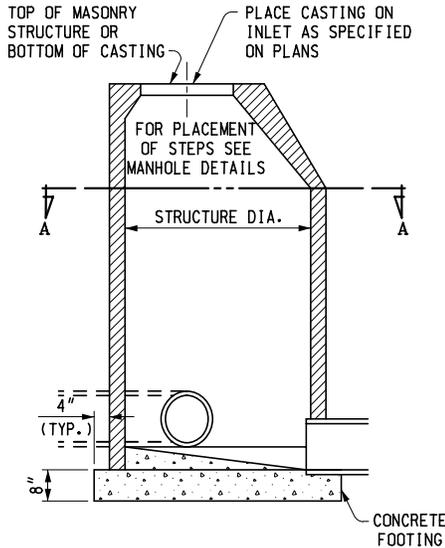


SEE MANHOLE DETAILS FOR SIZE AND BASE OPTIONS
SECTION B - B
INLET

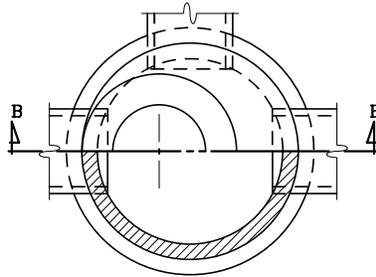


HALF SECTION A - A

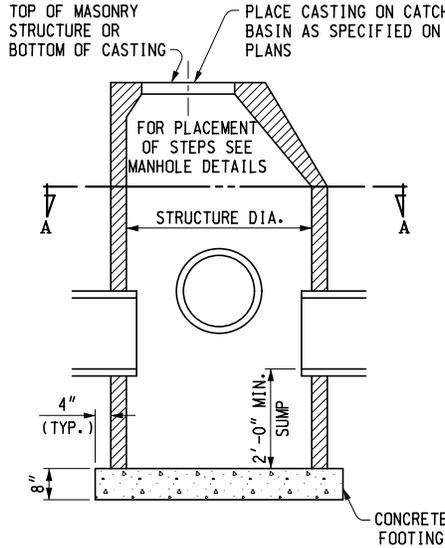



SEE MANHOLE DETAILS FOR SIZE AND BASE OPTIONS
SECTION B - B
CATCH BASIN

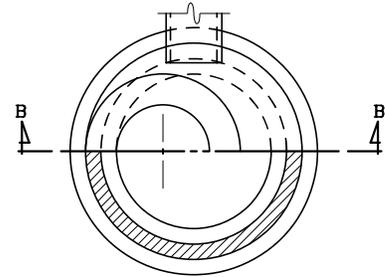



HALF SECTION A - A

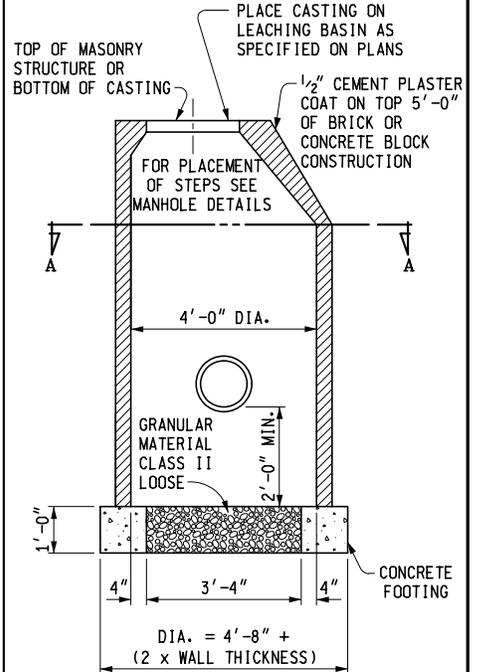



SEE MANHOLE DETAILS FOR BASE OPTIONS
SECTION B - B
LEACHING BASIN

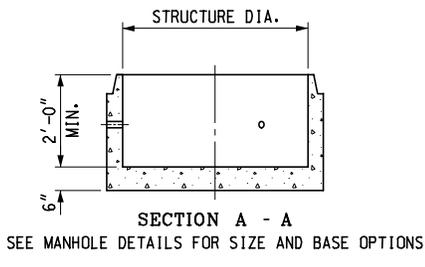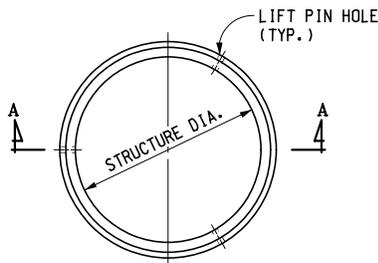

SECTION A - A
SEE MANHOLE DETAILS FOR SIZE AND BASE OPTIONS
PRECAST SUMP FOR PRECAST RISERS

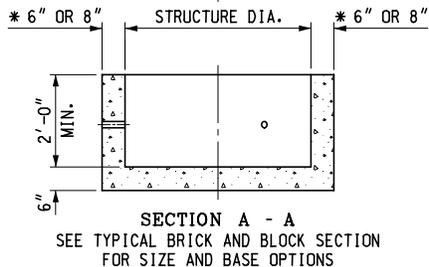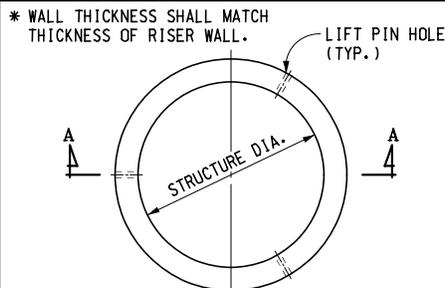

SECTION A - A
SEE TYPICAL BRICK AND BLOCK SECTION FOR SIZE AND BASE OPTIONS
PRECAST SUMP FOR BRICK OR BLOCK CONSTRUCTION

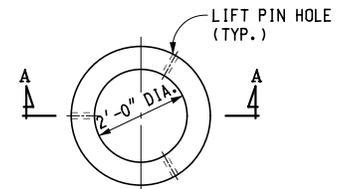

SECTION A - A
PRECAST SUMP FOR 2'-0" DIA. STRUCTURES

MICHIGAN DEPARTMENT OF TRANSPORTATION
BUREAU OF DEVELOPMENT STANDARD PLAN FOR

DRAINAGE STRUCTURES


5-18-2020
F.H.W.A. APPROVAL

9-19-2019
PLAN DATE


R-1-G

SHEET
2 OF 9

* 4 BLOCK MIN. FOR 4'-0" DIA. STRUCTURE
 6 BLOCK MIN. FOR 5'-0" DIA. STRUCTURE
 6 BLOCK MIN. FOR 6'-0" DIA. STRUCTURE

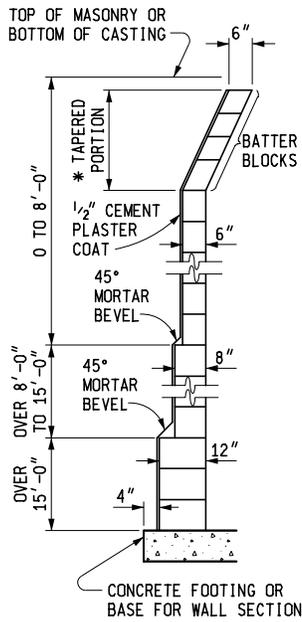


TYPICAL
 CONCRETE BLOCK
 WALL SECTION

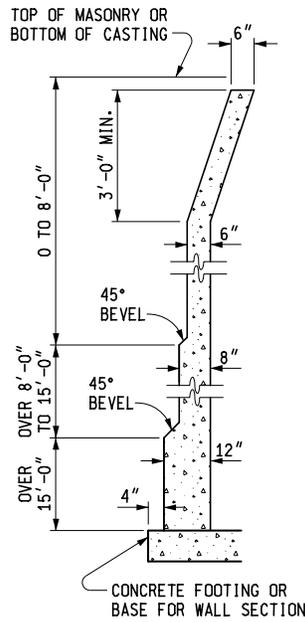


TYPICAL
 CAST-IN-PLACE
 CONCRETE
 WALL SECTION


* 5'-0" MIN. FOR 4'-0" DIA. STRUCTURE
 6'-0" MIN. FOR 5'-0" DIA. STRUCTURE
 6'-0" MIN. FOR 6'-0" DIA. STRUCTURE

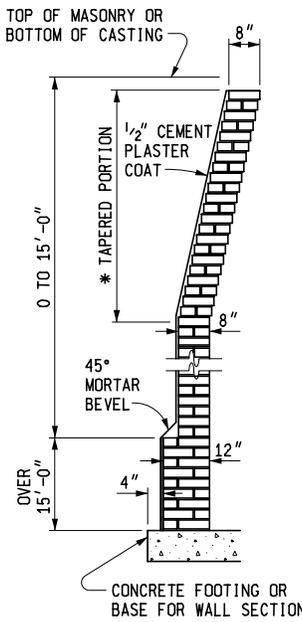


TYPICAL BRICK
 WALL SECTION

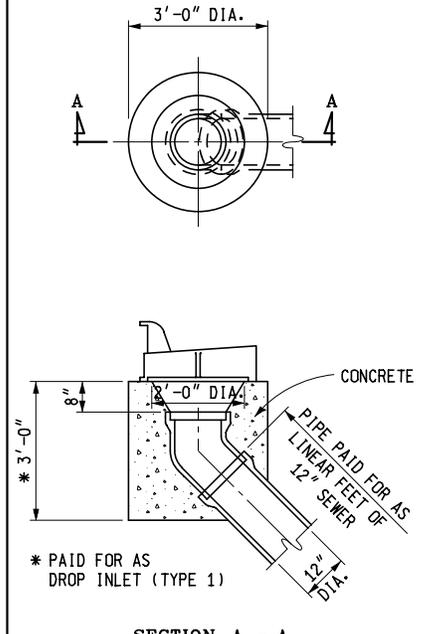


DROP INLET (TYPE 1)

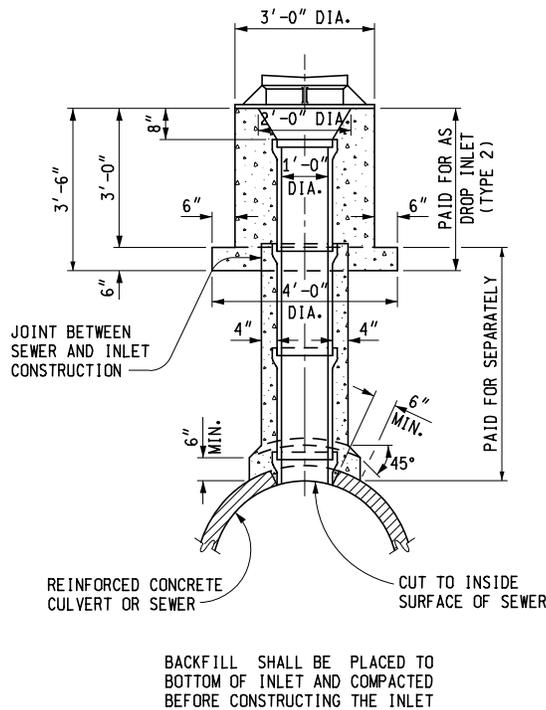

DROP INLET (TYPE 2)

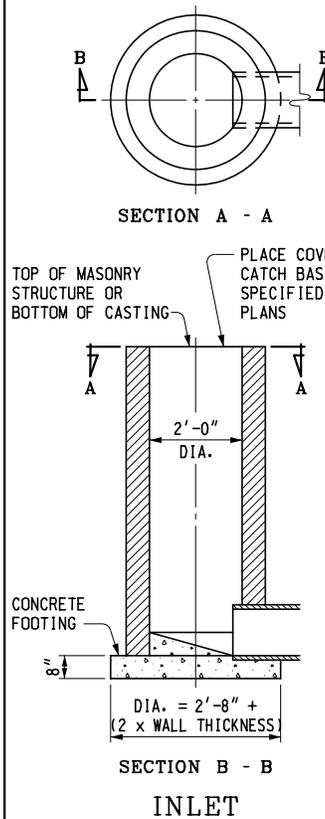

INLET

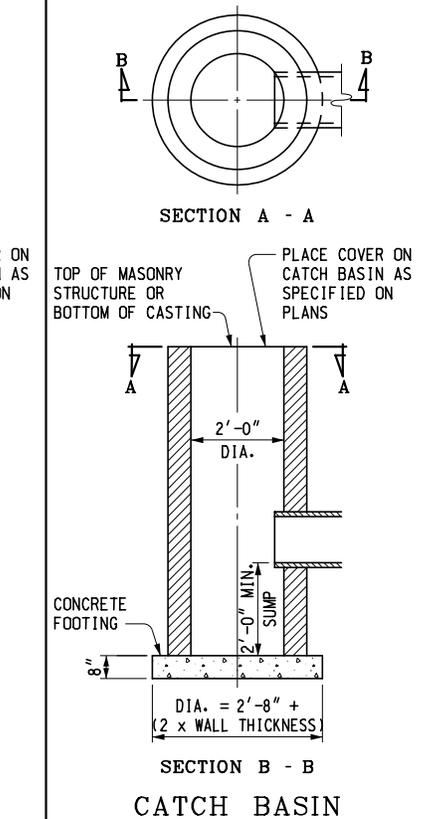


CATCH BASIN


MICHIGAN DEPARTMENT OF TRANSPORTATION
 BUREAU OF DEVELOPMENT STANDARD PLAN FOR

DRAINAGE STRUCTURES


5-18-2020 F.H.W.A. APPROVAL	9-19-2019 PLAN DATE	R-1-G	SHEET 3 OF 9
--------------------------------	------------------------	-------	-----------------

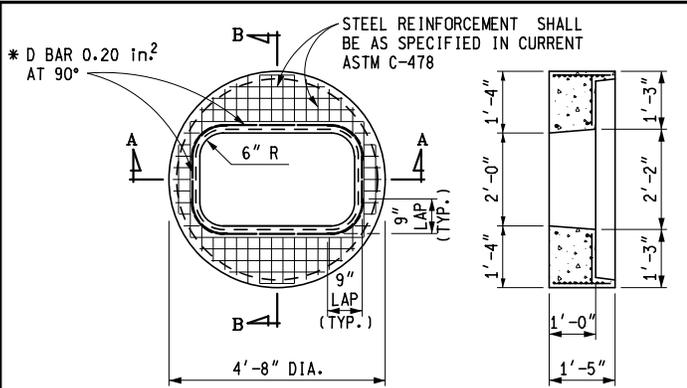


* D BARS MAY BE BENT AT A SMALLER RADIUS RATHER THAN PARALLELING THE RADIUS IN THE DRAIN OPENING

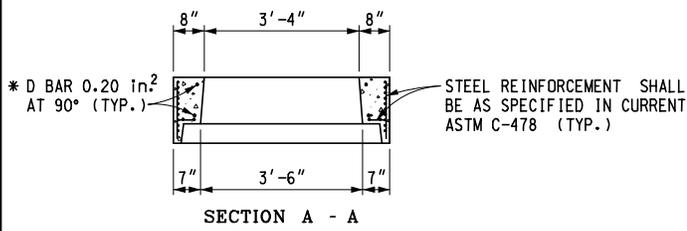


PRECAST FLAT SLAB TOP FOR PRECAST CONCRETE STRUCTURE, 2' x 4' CASTING

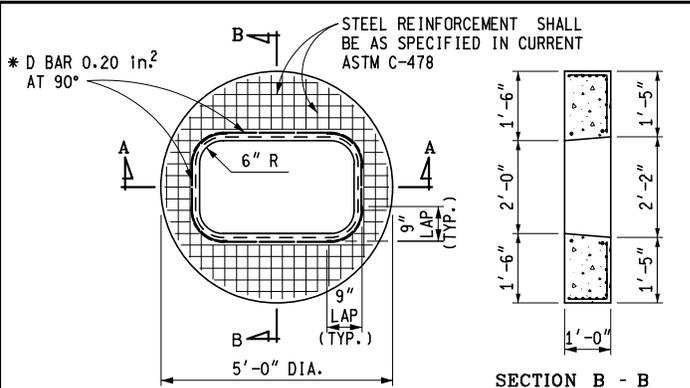


* D BARS MAY BE BENT AT A SMALLER RADIUS RATHER THAN PARALLELING THE RADIUS IN THE DRAIN OPENING

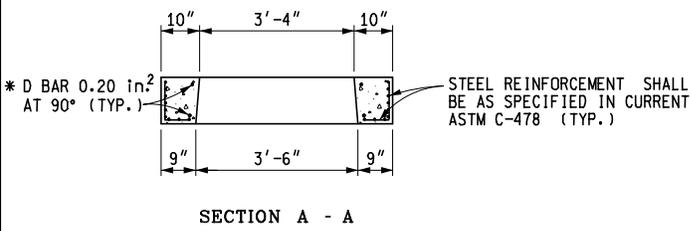

PRECAST FLAT SLAB TOP FOR MASONRY STRUCTURE, 2' x 4' CASTING

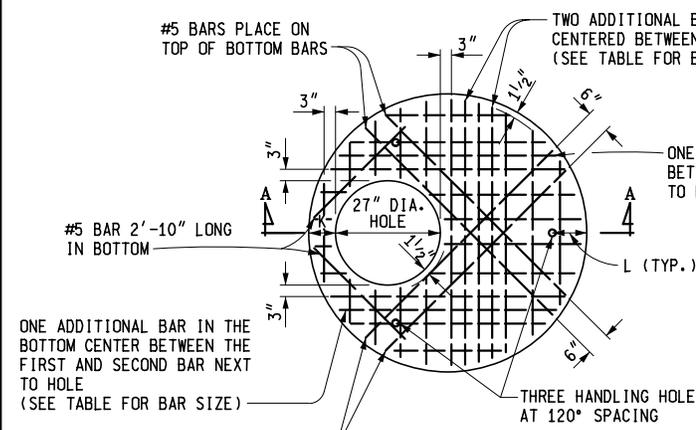

PLAN (SHOWING BOTTOM LAYER OF REINFORCEMENT)

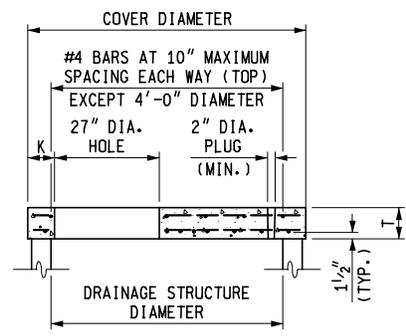



SECTION A - A
PRECAST REINFORCED CONCRETE FLAT SLAB TOP

TABLE OF DIMENSIONS					
STRUCTURE DIAMETER	COVER DIAMETER	T	K	L	BAR MAXIMUM SPACING (BOTTOM EACH WAY)
* 4'-0"	58"	6"	6"	8"	#5 AT 6"
5'-0"	72"	8"	7"	9"	#5 AT 7"
6'-0"	86"	8"	8"	10"	#5 AT 6"
7'-0"	101 1/2"	12"	8 3/4"	11"	#5 AT 5"
8'-0"	114"	12"	9"	11"	#6 AT 6"
9'-0"	128"	12"	10"	12"	#5 AT 6"
10'-0"	140"	12"	10"	13"	#5 AT 6"

* ONLY BOTTOM LAYERS OF STEEL NECESSARY



MICHIGAN DEPARTMENT OF TRANSPORTATION
BUREAU OF DEVELOPMENT STANDARD PLAN FOR

DRAINAGE STRUCTURES

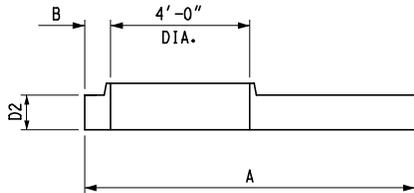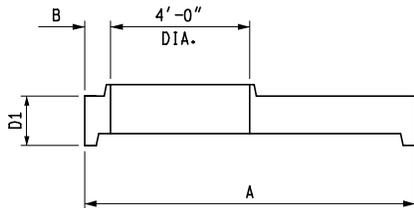


PRECAST REDUCER CAP

REDUCER CAP DIMENSIONS				
STRUCTURE DIAMETER	CAP DIAMETER "A"	B	CAP DEPTH "D1"	CAP DEPTH "D2"
7'-0"	101 1/2"	8 3/4"	1'-5"	12"
8'-0"	114"	9"	1'-5"	12"
9'-0"	128"	10"	1'-5"	12"
10'-0"	140"	10"	1'-6"	12"

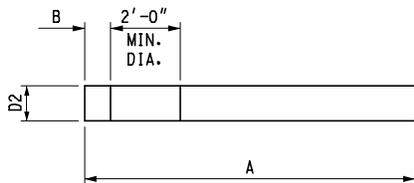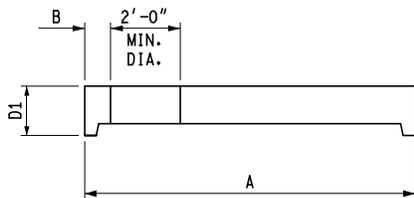

PRECAST FLAT SLAB TOP

FLAT SLAB TOP DIMENSIONS				
STRUCTURE DIAMETER	COVER DIAMETER "A"	B	COVER DEPTH "D1"	COVER DEPTH "D2"
7'-0"	101 1/2"	8 3/4"	1'-5"	12"
8'-0"	114"	9"	1'-5"	12"
9'-0"	128"	10"	1'-5"	12"
10'-0"	140"	10"	1'-6"	12"

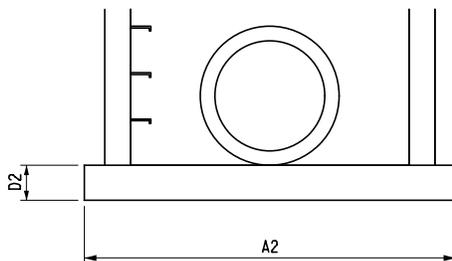

SEPARATE BASE OPTION

BASE AND RISER DIMENSIONS					
STRUCTURE DIAMETER	BASE DIAMETER "A1"	BASE DIAMETER "A2"	MIN. WALL THICKNESS "T"	BASE DEPTH "D1"	BASE DEPTH "D2"
7'-0"	101 1/2"	108"	7"	8"	12"
8'-0"	114"	128"	8"	8"	12"
9'-0"	128"	140"	9"	8"	12"
10'-0"	140"	154"	10"	8"	12"

MICHIGAN DEPARTMENT OF TRANSPORTATION
BUREAU OF DEVELOPMENT STANDARD PLAN FOR


DRAINAGE STRUCTURES

5-18-2020
F.H.W.A. APPROVAL


9-19-2019
PLAN DATE

R-1-G


SHEET
5 OF 9

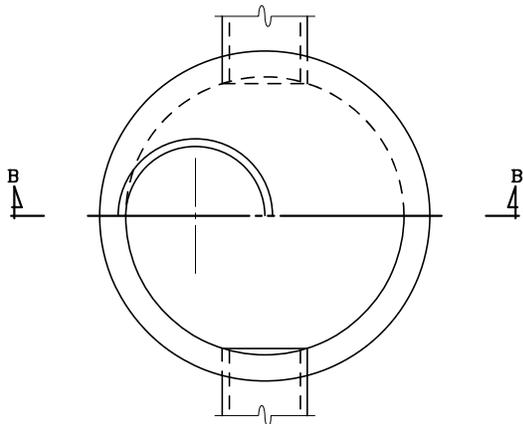

HALF SECTION A - A

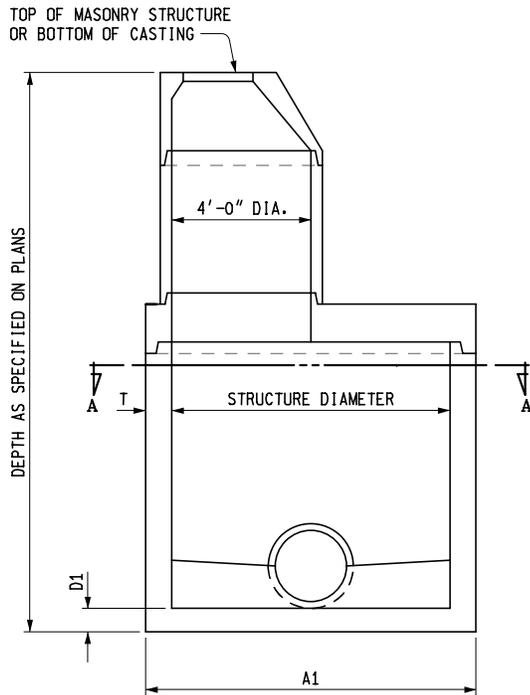

SECTION B - B
SHOWING REDUCER CAP

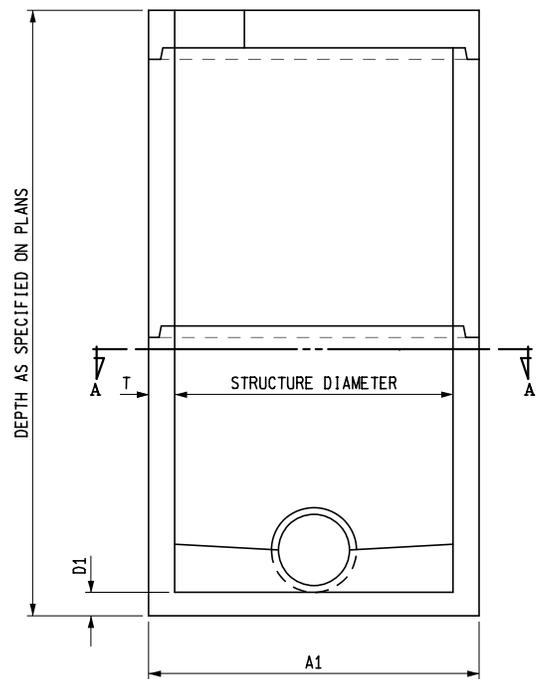

SECTION B - B
SHOWING FLAT SLAB TOP

PRECAST MANHOLE

MICHIGAN DEPARTMENT OF TRANSPORTATION
BUREAU OF DEVELOPMENT STANDARD PLAN FOR


DRAINAGE STRUCTURES

5-18-2020
F.H.W.A. APPROVAL

9-19-2019
PLAN DATE


R-1-G

SHEET
6 OF 9

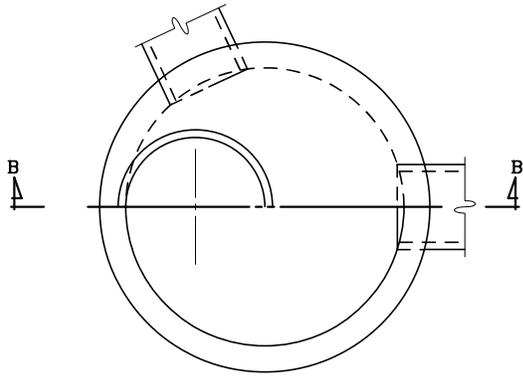


HALF SECTION A - A

TOP OF MASONRY STRUCTURE
OR BOTTOM OF CASTING

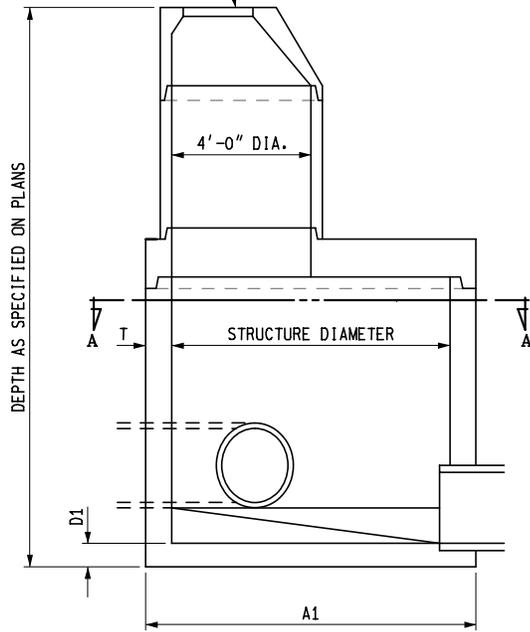

SECTION B - B
SHOWING REDUCER CAP

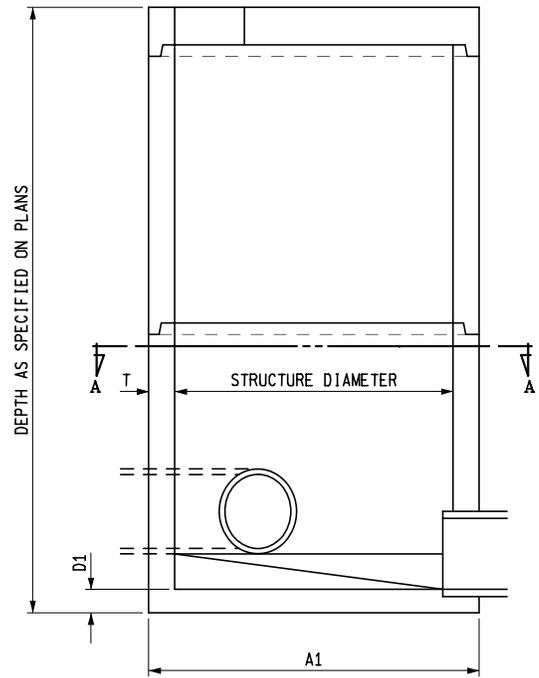

SECTION B - B
SHOWING FLAT SLAB TOP

PRECAST INLET

MICHIGAN DEPARTMENT OF TRANSPORTATION
BUREAU OF DEVELOPMENT STANDARD PLAN FOR


DRAINAGE STRUCTURES

5-18-2020
F.H.W.A. APPROVAL


9-19-2019
PLAN DATE

R-1-G


SHEET
7 OF 9

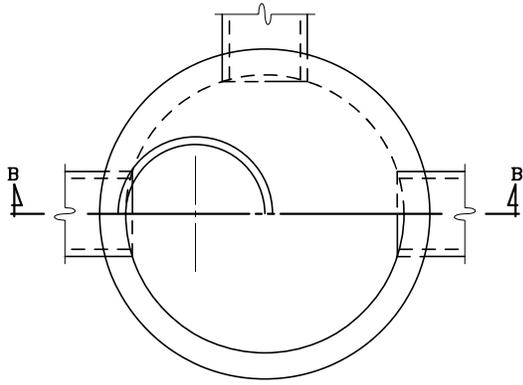

HALF SECTION A - A

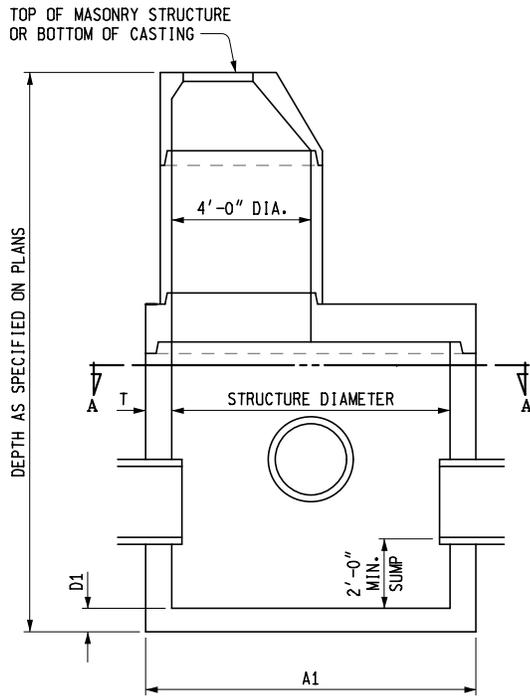

SECTION B - B
SHOWING REDUCER CAP

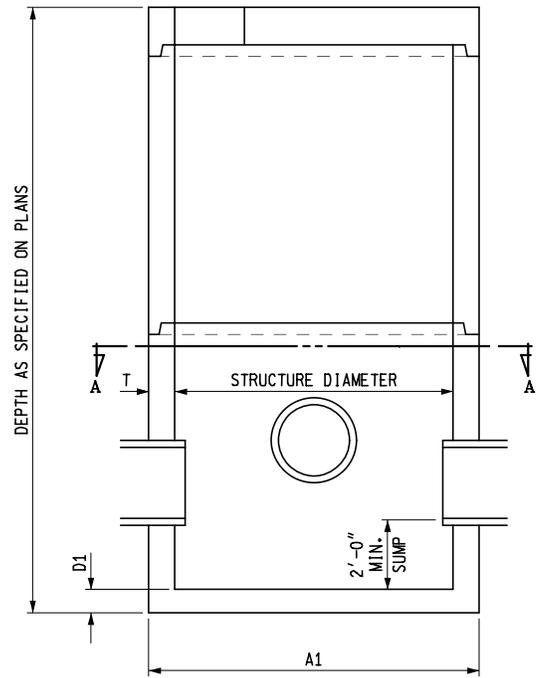

SECTION B - B
SHOWING FLAT SLAB TOP

PRECAST CATCH BASIN

MICHIGAN DEPARTMENT OF TRANSPORTATION
BUREAU OF DEVELOPMENT STANDARD PLAN FOR



DRAINAGE STRUCTURES

5-18-2020
F.H.W.A. APPROVAL

9-19-2019
PLAN DATE

R-1-G

SHEET
8 OF 9

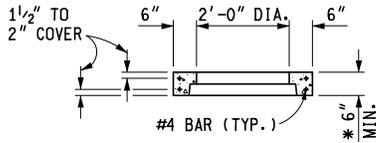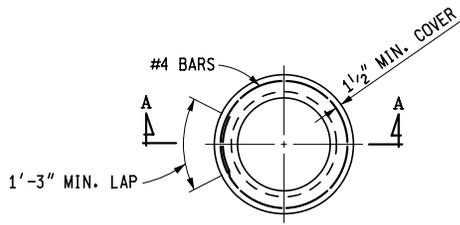

SECTION A - A

* WHEN RISER TONGUE LENGTH IS GREATER THAN 3", USE 2 TIMES THE TONGUE LENGTH.

NOTE: PRECAST RISER SHALL FULLY ENGAGE THE TONGUE OF THE RISER PIPE.

PRECAST RISER RING
(FOR 2'-0" DIAMETER STRUCTURE)

NOTES:

THE DRAINAGE STRUCTURE COVERS ALLOWED FOR USE ON THESE DRAINAGE STRUCTURES ARE SPECIFIED IN SUBSEQUENT STANDARD PLANS AND ARE INTERCHANGEABLE ON ANY STRUCTURE.

THE TOPS OF MASONRY STRUCTURES SHALL BE SUFFICIENTLY LOW TO PERMIT PROPER ADJUSTMENT OF COVER TO GRADE USING MORTAR OR BRICK AS DIRECTED BY THE ENGINEER.

PREMIUM JOINTS ARE REQUIRED ON ALL SANITARY MANHOLES. SEE ASTM DESIGNATION C-923.

GRANULAR MATERIAL CLASS III SHALL BE USED IN BACKFILLING AROUND ALL STRUCTURES THAT FALL WITHIN THE 1:1 INFLUENCE LINES FROM THE EDGE OF PAVEMENT OR BACK OF CURB.

STEPS FOR DRAINAGE STRUCTURES SHALL BE OF AN APPROVED DESIGN AND MADE FROM CAST IRON, ALUMINUM, OR PLASTIC COATED STEEL. RUNGS SHALL BE A MINIMUM OF 10" IN CLEAR LENGTH, DESIGNED TO PREVENT THE FOOT FROM SLIPPING OFF THE END. THE MINIMUM HORIZONTAL PULL OUT LOAD SHALL BE 400 LBS. THE MINIMUM VERTICAL LOAD SHALL BE 800 LBS.

THE BELL SHALL BE REMOVED FOR THE FIRST LENGTH OF OUTLET PIPE PROJECTING THROUGH THE WALL OF THE MANHOLE.

PRECAST CONCRETE SECTIONS, SUMPS, BASE SECTIONS, AND FLAT TOP SLABS SHALL BE BUILT ACCORDING TO CURRENT ASTM C-478 AND ACCORDING TO DETAILS SPECIFIED ON THIS PLAN. PRECAST REINFORCED CONCRETE FLAT TOP SLAB SHALL BE MARKED TO SHOW LOCATION OF REINFORCEMENT. THE WALLS OF THE PRECAST UNITS MAY HAVE A SLIGHT TAPER TO ALLOW FOR FORM REMOVAL. PRECAST CONCRETE 2'-0" DIAMETER DRAINAGE STRUCTURES SHALL HAVE A MINIMUM 3" WALL THICKNESS WITH A 6" MINIMUM BEARING SURFACE ON TOP. SEE PRECAST RISER RING FOR 2'-0" DIAMETER STRUCTURE.

THE MAXIMUM INSIDE DIAMETER OF PIPES ENTERING OR LEAVING PRECAST DRAINAGE STRUCTURES SHALL BE 2'-0" LESS THAN THE INSIDE DIAMETER OF THE DRAINAGE STRUCTURE. A PIPE LEAVING A 2'-0" DIAMETER DRAINAGE STRUCTURE IS ALLOWED TO HAVE 1'-0" INSIDE DIAMETER OR LESS.

THE NUMBER OF PIPE OPENINGS IN A RISER SHALL BE DETERMINED BY THE DESIGNER. SPACING BETWEEN OPENINGS SHALL BE 1'-0" MINIMUM. OPENINGS MAY BE CONSTRUCTED BY CASTING OR SCRIBING IN PRECAST STRUCTURES DURING FABRICATION OR BY CORING THE CURED CONCRETE.

PRECAST CONCRETE FOOTINGS OR BASES SHALL BE REINFORCED WITH #4 BARS SPACED AT 1'-0" BOTH WAYS OR WITH TWO LAYERS OF WELDED WIRE FABRIC OF EQUIVALENT CROSS SECTIONAL AREA LAID AT RIGHT ANGLES AND WIRED TOGETHER. REINFORCEMENT SHALL BE PLACED IN TOP OF FOOTING AND SHALL BE MARKED.

PRECAST CONCRETE FOOTINGS SHALL BE SUPPORTED BY A COMPACTED 6" GRANULAR SUBBASE.

THE MINIMUM WALL THICKNESS FOR ALL 2'-0", 4'-0", 5'-0", AND 6'-0" DRAINAGE STRUCTURES USING CONCRETE BLOCK, BRICK, OR CAST-IN-PLACE CONCRETE SHALL BE AS SPECIFIED IN TYPICAL WALL SECTIONS.

THE CONICAL SECTION OF MANHOLES OR CATCH BASINS CONSTRUCTED OF BLOCK OR BRICK SHALL BE SHROUDED WITH GEOTEXTILE FABRIC TO A MINIMUM DEPTH OF 5'-0" OR THROUGH THE FROST ZONE. ENOUGH GEOTEXTILE MATERIAL SHALL BE LEFT ON THE TOP (8" OR MORE) TO ROLL OVER THE TOP OF THE CONE.

PREFORMED HIGH DENSITY POLYSTYRENE FILLER PIECES MAY BE USED TO CHANNEL FLOW IN THE BOTTOM OF MANHOLES PROVIDED THEY HAVE AT LEAST 2" OF CONCRETE COVER. THE USE OF THIS MATERIAL FOR CHANNEL FLOW IS RESTRICTED TO MANHOLES WHERE THE BOTTOM SECTION IS NOT SUBJECT TO FREEZING. THE USE OF THIS MATERIAL MUST BE APPROVED BY THE ENGINEER.

MICHIGAN DEPARTMENT OF TRANSPORTATION
BUREAU OF DEVELOPMENT STANDARD PLAN FOR

DRAINAGE STRUCTURES

5-18-2020 F.H.W.A. APPROVAL	9-19-2019 PLAN DATE	R-1-G	SHEET 9 OF 9
--------------------------------	------------------------	-------	-----------------